



Expertise Applied | Answers Delivered

Littelfuse, Inc.
6133 North River Road, Suite 500
Rosemont, IL 60018 USA
(773) 628-1000

Subject: SE-325 Units with permanent replacement switches for GF, MODE, and RES setting
Document: LFPCN_RC00108
Date Released: Aug 27, 2026

Dear Valued Customer,

This notice is to advise that SE-325 Series Ground-Fault Ground-Check Monitors will be permanently manufactured with a raised (protruding) switch for the 3-position GF setting, the 2-position MODE setting, and 2-position RES setting to replace the previous flush switches. All new switches will have the same functionality and performance as the previous versions.


The products affected are the following:

- SE-325
- SE-325D
- SE-325DN
- SE-325DNT
- SE-325DS
- SE-325DSN
- SE-325DSNT
- SE-325DST
- SE-325DT
- SE-325E
- SE-325EN
- SE-325ENT
- SE-325ES
- SE-325ESN
- SE-325ESNT
- SE-325EST
- SE-325ET
- SE-325N
- SE-325NT
- SE-325P
- SE-325S
- SE-325SN
- SE-325SNT
- SE-325ST
- SE-325T



Expertise Applied | Answers Delivered

Littelfuse, Inc.
6133 North River Road, Suite 500
Rosemont, IL 60018 USA
(773) 628-1000

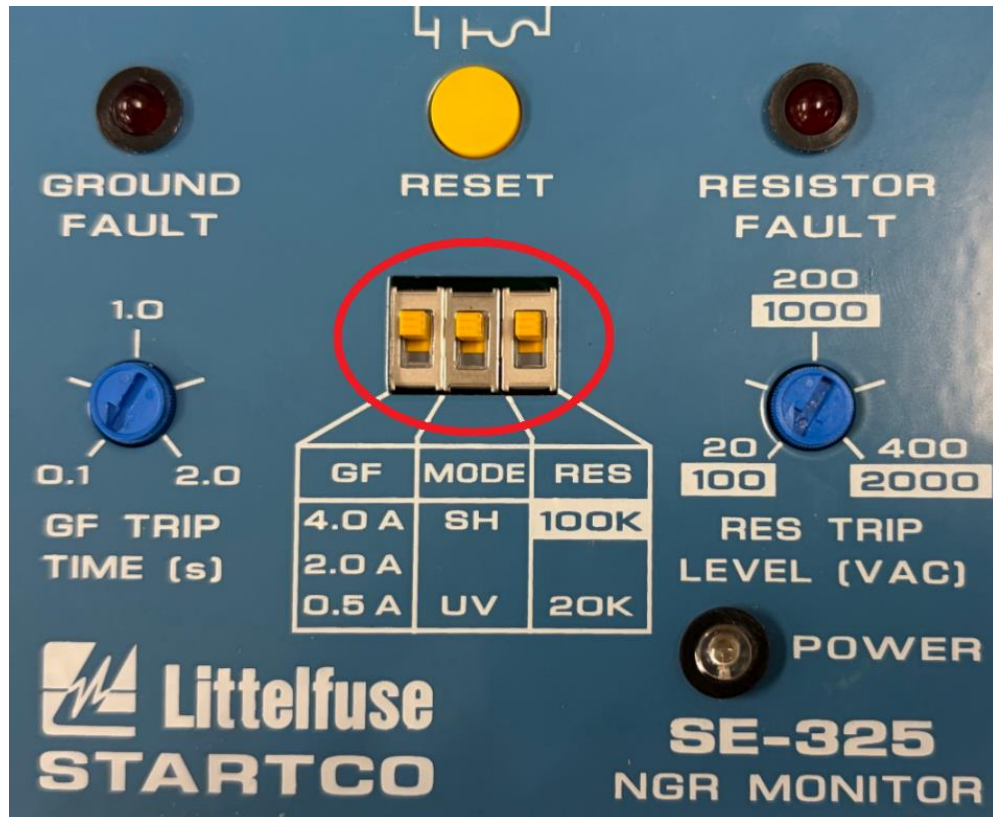

The effective date of this product update is to be Aug 27, 2026.

For questions or concerns, please contact technical support at relays@littelfuse.com or 1-800-832-3873.

Sincerely,

Logean Hansen
Associate Product Manager
Industrial Business Unit, Protection Relays
Littelfuse, Inc.